
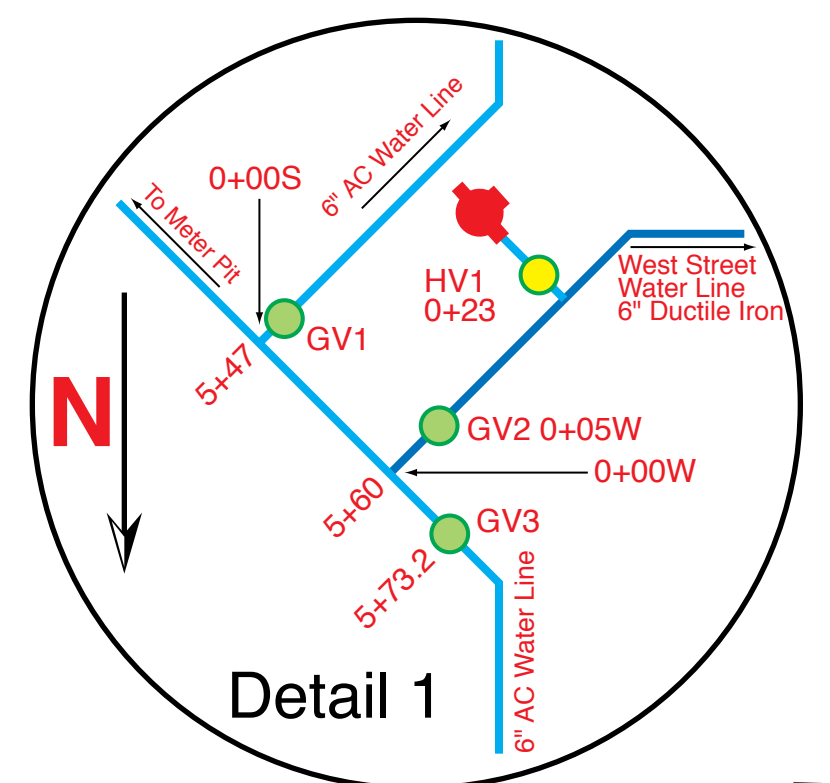
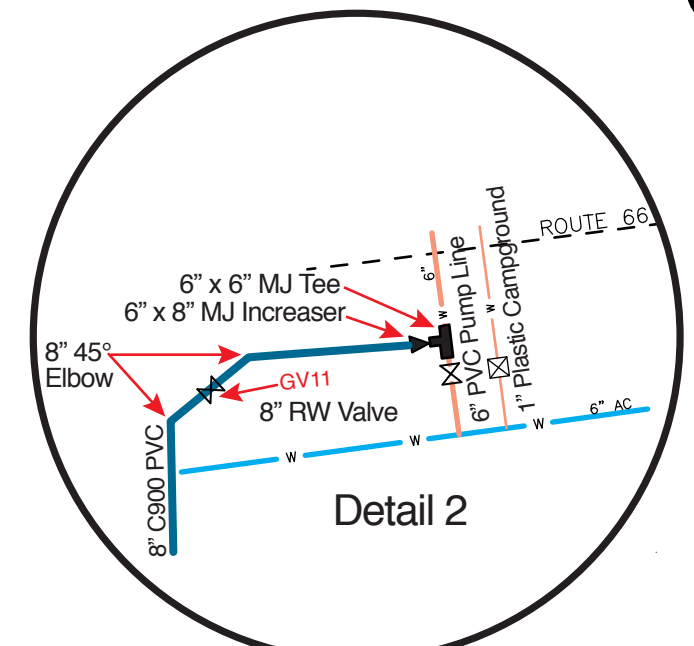


# Randolph Fire District #1 System Map – 2020

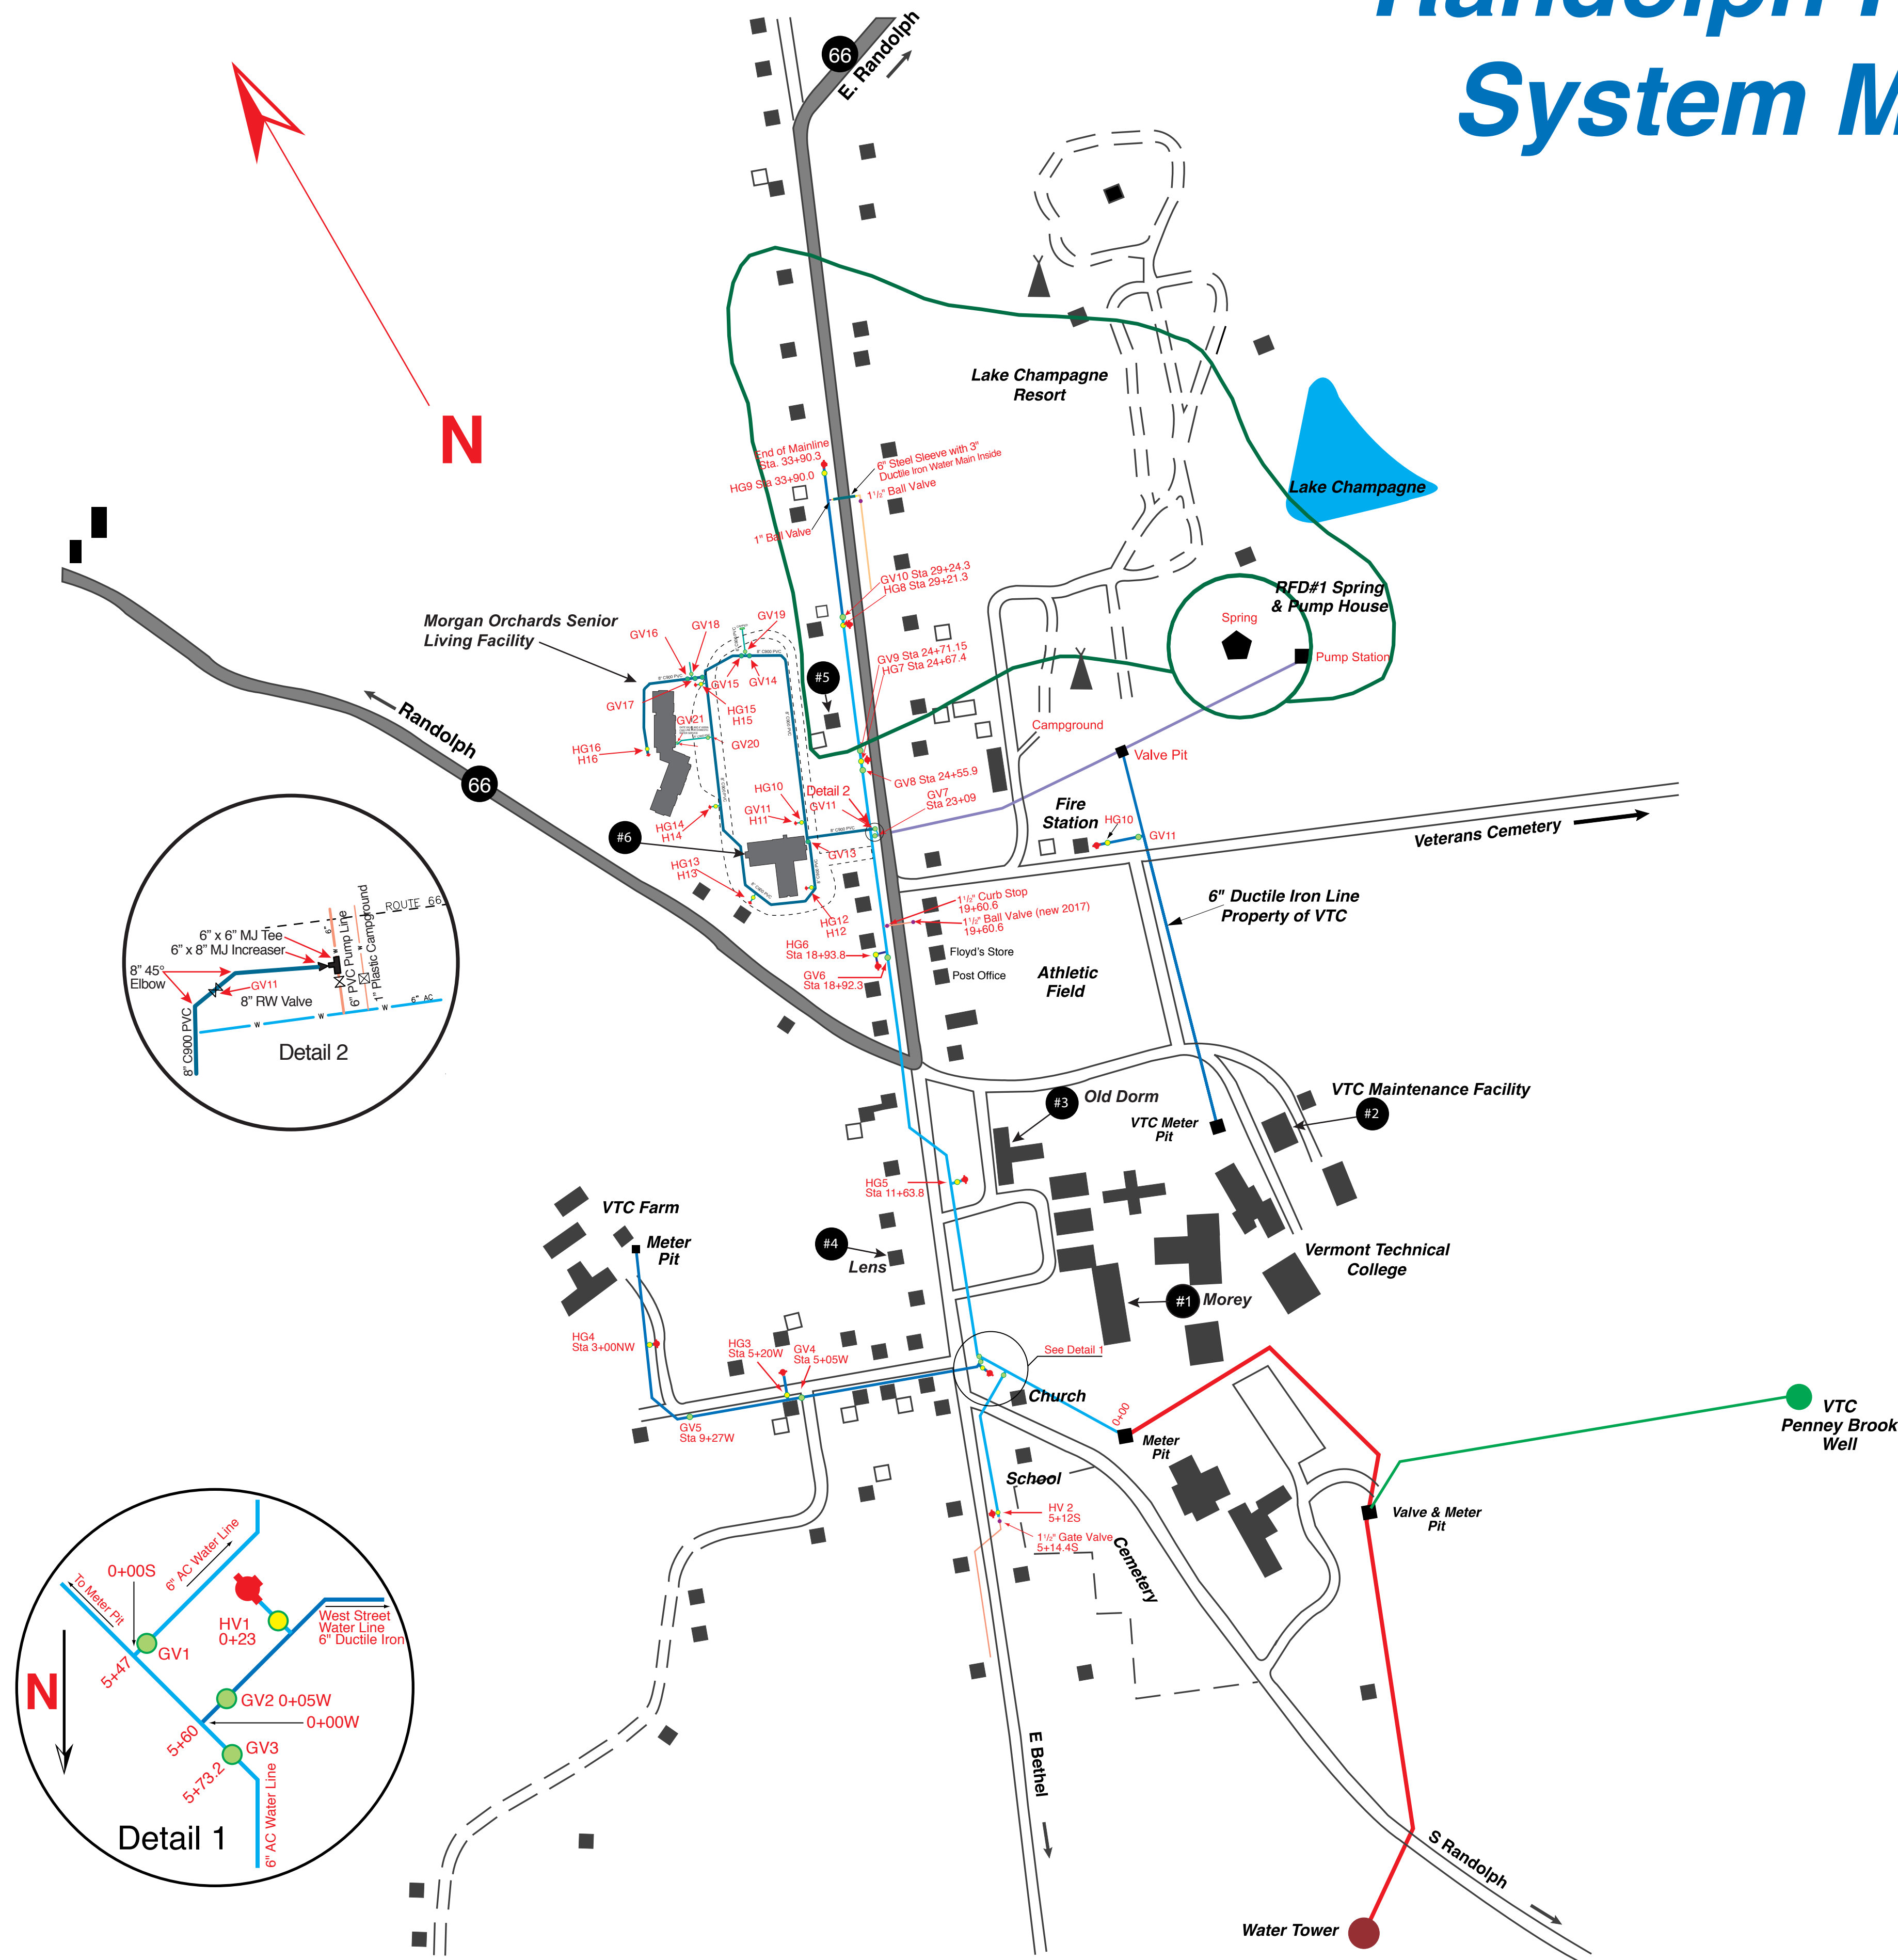

### Legend

- 8" AWWA C900 PVC
- 6" AWWA C900 pvc
- 6" Ductile Iron Water Main
- 6" Asbestos Cement Water Main
- 6" PVC Pump Line from Spring
- 6" Steel Sleeve
- 3" Ductile Iron Water Main
- 1 1/2" Polyethylene Water Main
- 1" Copper Feed Line
- VTC Mains From Tower
- 4" DI Pump Line from well
- 250,000 Gal Water Tower
- + Hydrants
- 8" Main Line Valve (GV)
- 6" Main Line Valve (GV)
- 4" Gate Valve (GV)
- 6" Hydrant Valve (HV)
- 1 1/2" Main Line Valve
- 1" Ball Valve